


# RAZOR® HD EBR-9 BDC MOA Reticle Subtensions for 1-10x24

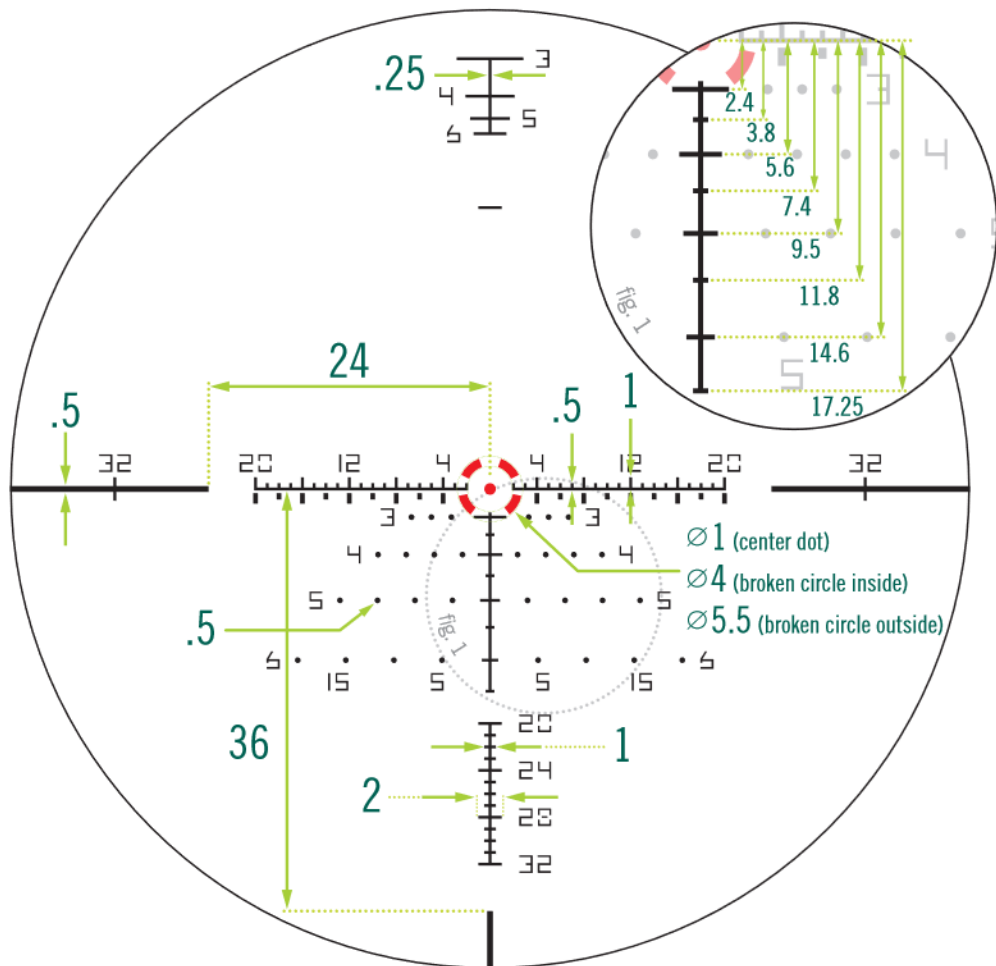

## ....[NOTES]....

Subtensions are measured in MOA and remain constant at all magnifications.  
Ø=Diameter

Reticle image shown for representation only. Reticle image may vary between models, magnification, or reticle plane.