


# RAZOR® HD GEN III EBR-7D MRAD Reticle Subtensions for 6-36x56

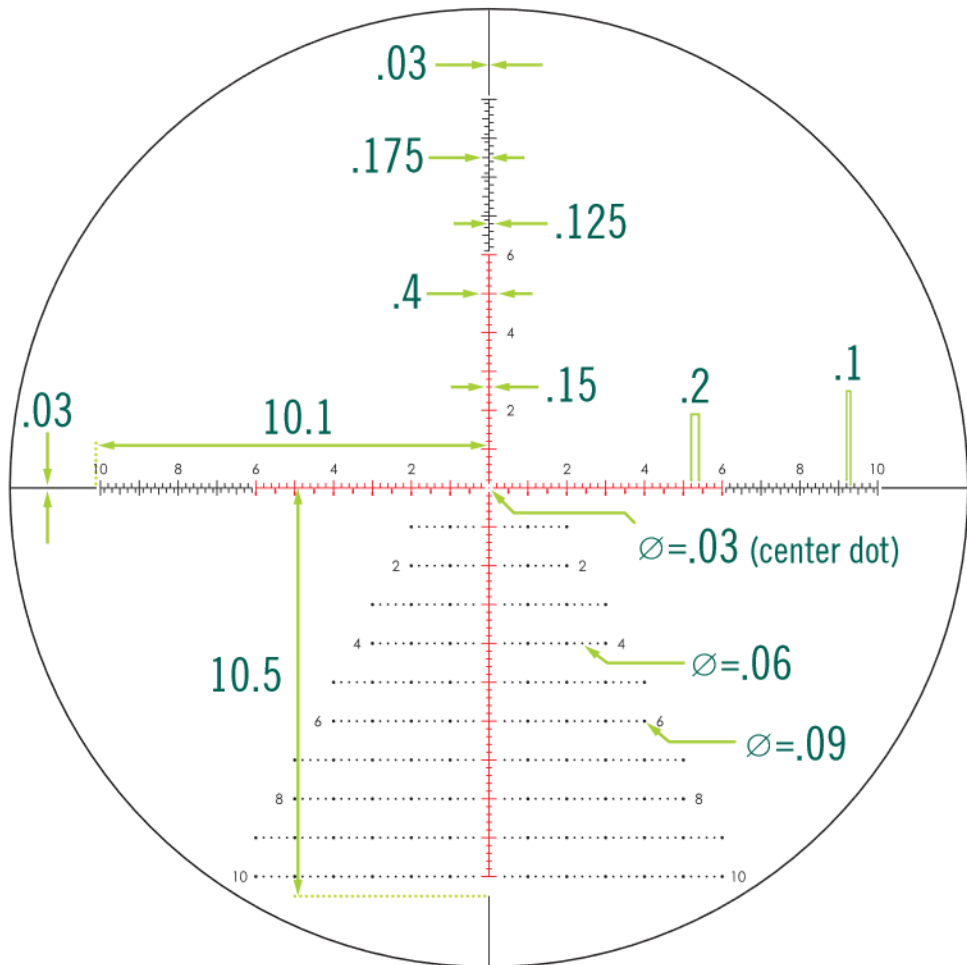

## ....[NOTES]....

Subtensions are measured in MRAD and remain constant at all magnifications.

Reticle image shown for representation only. The overall reticle image will vary with changes in the magnification.