


VIPER PST GEN II EBR-4 MRAD Reticle Subtensions for 2-10x32 FFP

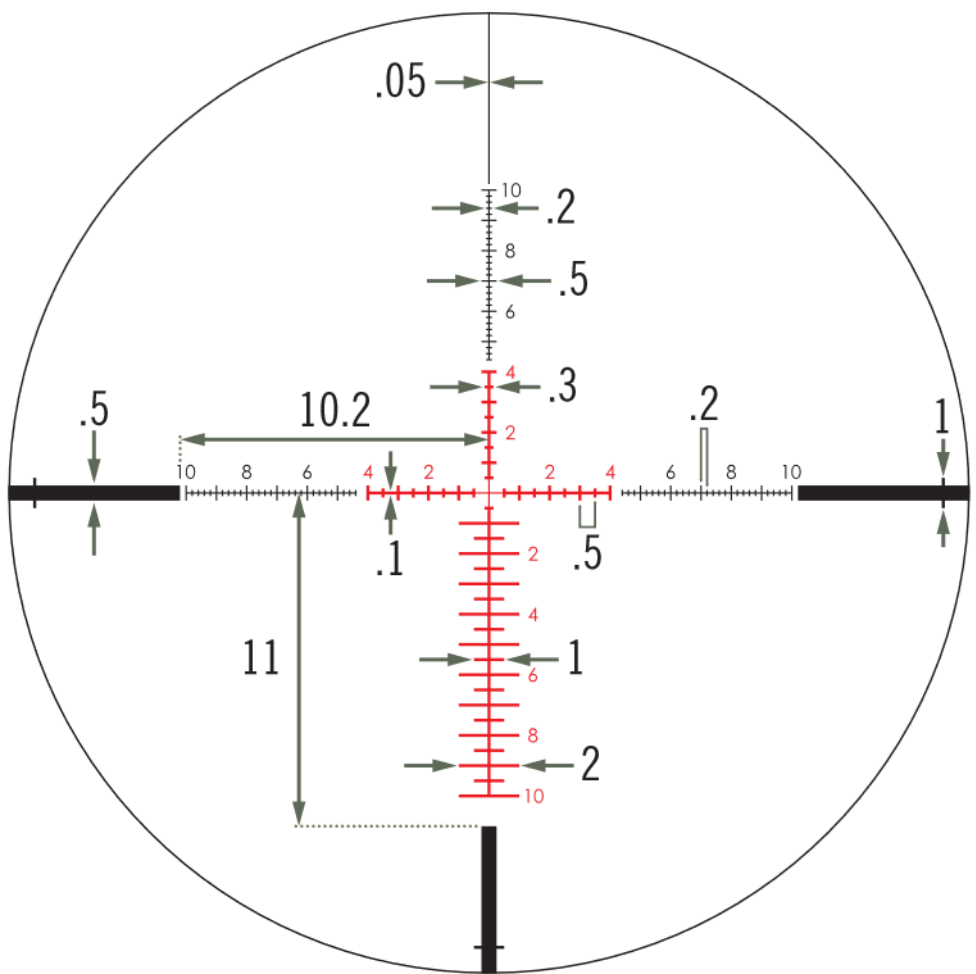

....[NOTES]....

Subtensions are measured in MRAD and remain constant at all magnifications.

Reticle image shown for representation only. Reticle image may vary between models, magnification, or reticle plane.